


MaxiPark-Trunk



MaxiPark

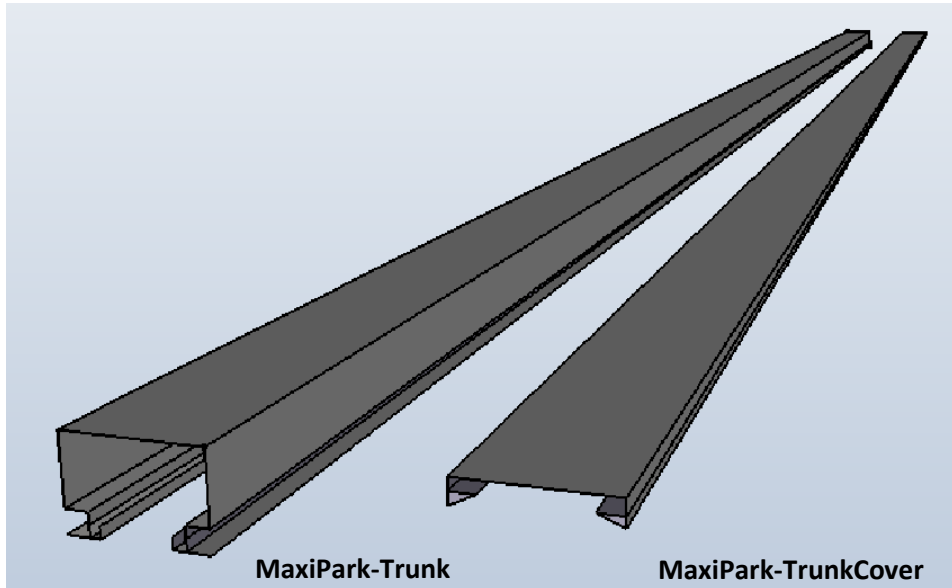

Specification of the trunking

Characteristics		Test conditions	Method test	test data	data unit
<u>Fundamental characteristics</u>	Density	23°C	GB/T1033-1986	1.61	g/cm ³
	<u>Melt mass-flow rate</u>	170°C, 21.6kg	GB/T3682-2000	2.2	g/10min
<u>Mechanical Performance</u>	<u>Flexural Strength</u>		GB/T9341-2000	61.4	MPa
	<u>Elongation ratio</u>		GB/T1040-1992	35	%
	<u>compressive strength</u>		GB/T1041-1992	59.0	MPa
<u>Thermal performance</u>	Vicat Softening Temperature		GB/T1633-2000	101.7	°C
	<u>Distortion temperature</u>	1.82MPa	GB/T1634-2004	60	°C